


INSPECTION REMINDER

If work is ready to be inspected, please call

(307) 686-5256


Please leave the following information when you call.

- The Application/Permit Number
- Physical Address
- Contact Name
- Contact Phone Number
- And the type of Inspection you are requesting

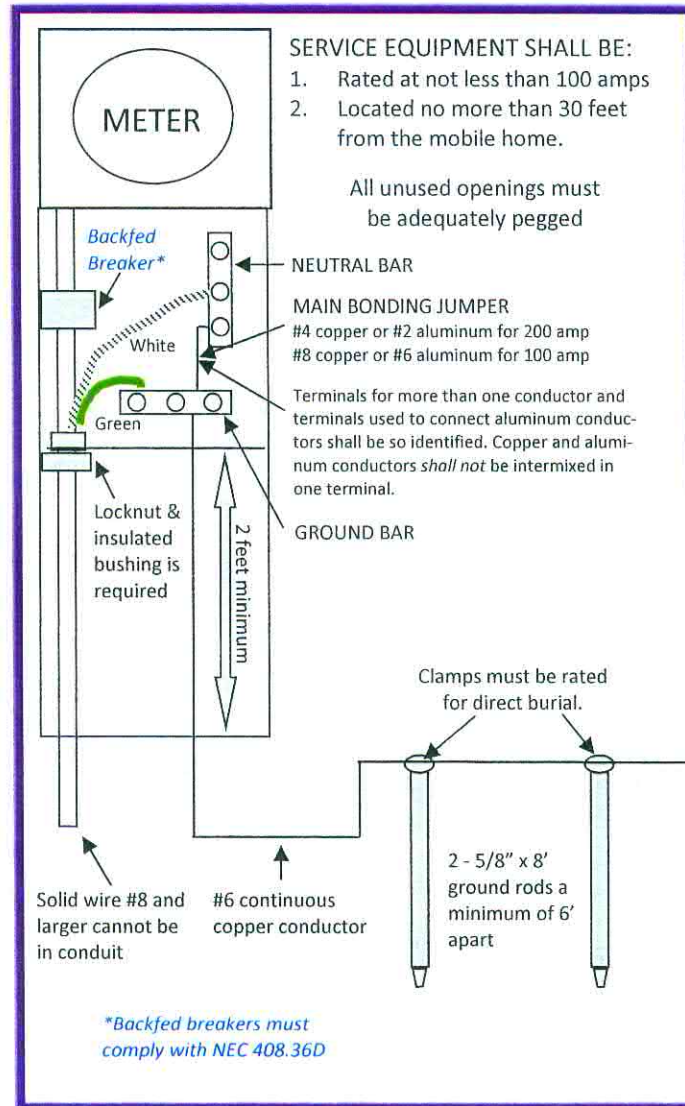


SERVICE with
P R I D E
Productivity Responsibility Integrity Dedication Enthusiasm

City of Gillette

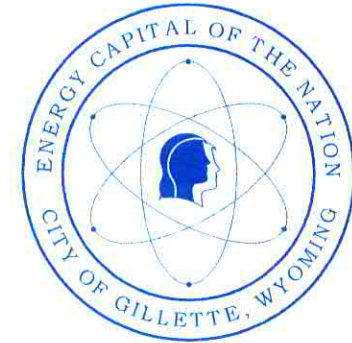

Mobile Home Electrical Service Requirements

Building Inspection Division
(307) 686-5260

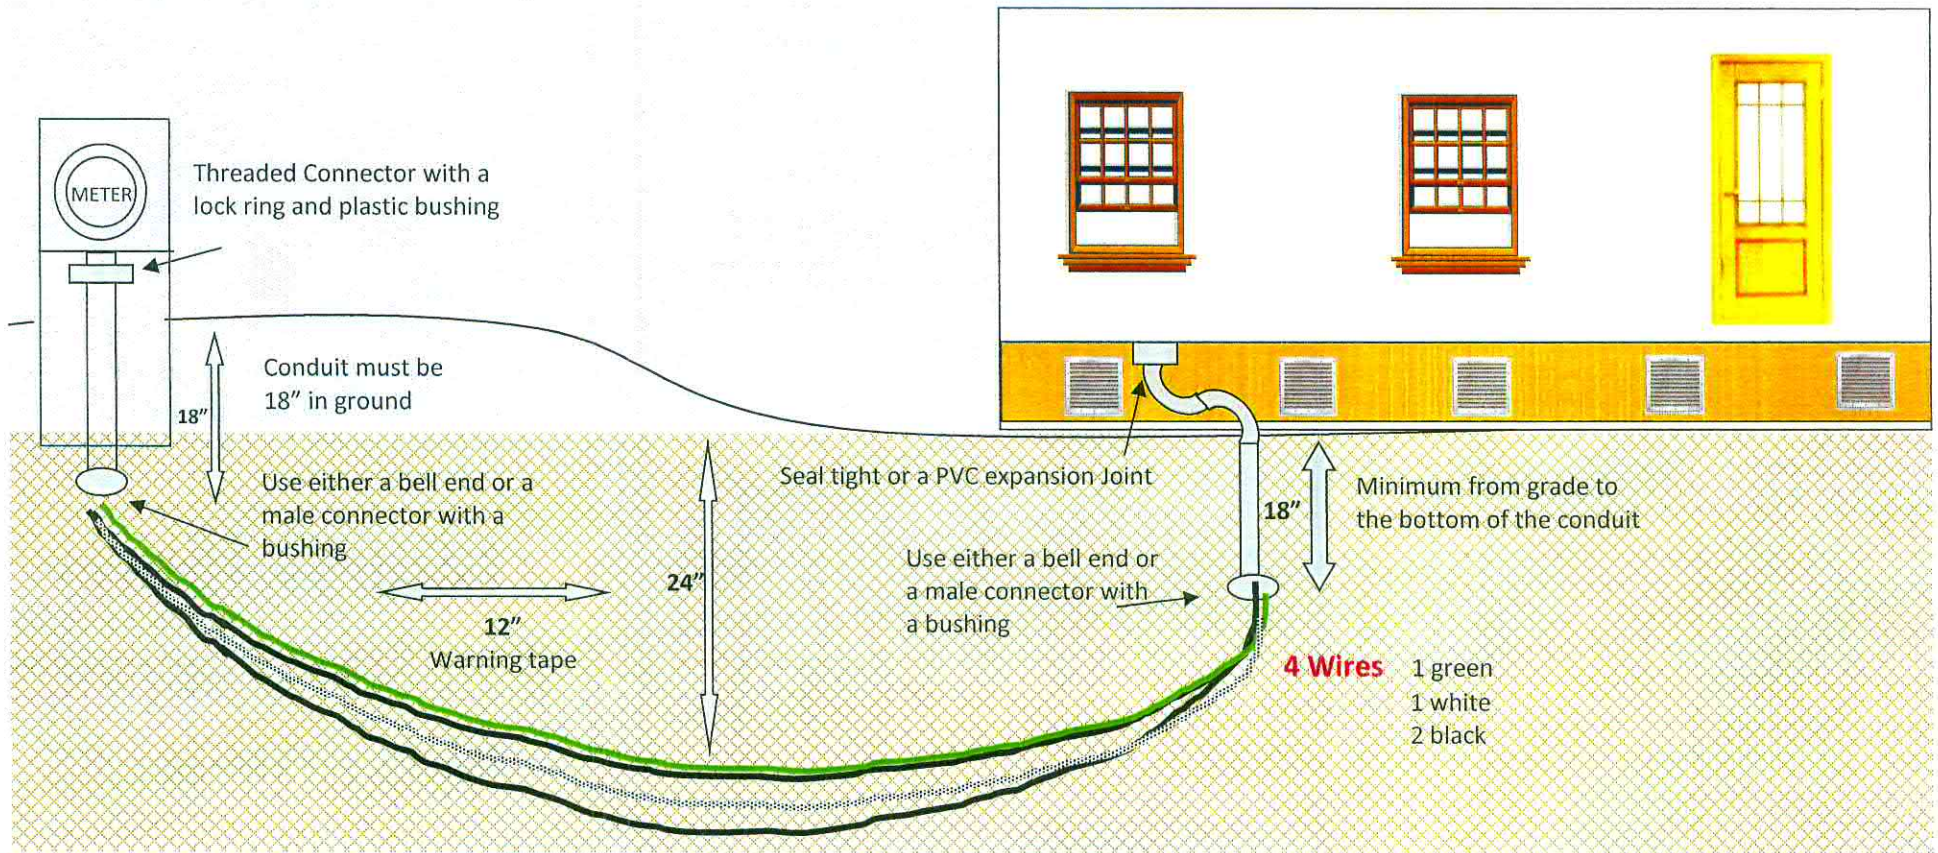

**Feeder conductors shall be sized according to the tag on the mobile home.
If the tag on the mobile home is more than 50 amperes, then it can not be cord connected.**

Conductor Size

100 amp—3 #4 copper or #2 aluminum & 1 #8 copper or #6 aluminum.
200 amp—3 #2/0 copper or 4/0 aluminum & 1 #6 copper or #4 aluminum.

Ground Wire must be identified by green coloring or marking.

Neutral Wire must be identified by white coloring or marking.

Burial Depths

Rigid metal conduit or imc	6"
PVC	18"
Direct Burial Cable	24"

Conduit is also allowed to lay on top of the ground under the mobile home as long as it is secured every five (5) feet.